


WING C

NOTE 1: EXISTING DOOR HOLD OPENS TO NEW SYSTEM.
 NOTE 2: DISCONNECT POWER TO AUTO-OPENING DOOR UPON FIRE ALARM ACTIVATION.
 NOTE 3: DISCONNECT POWER TO FIRE ALARM SYSTEM UPON FIRE ALARM SYSTEM ACTIVATION.
 NOTE 4: LOCATION FOR VERTICAL RISERS RUN TO ALL FLOORS. INSTALL PANELS ON EXTERIOR OF SHAFT WALL.

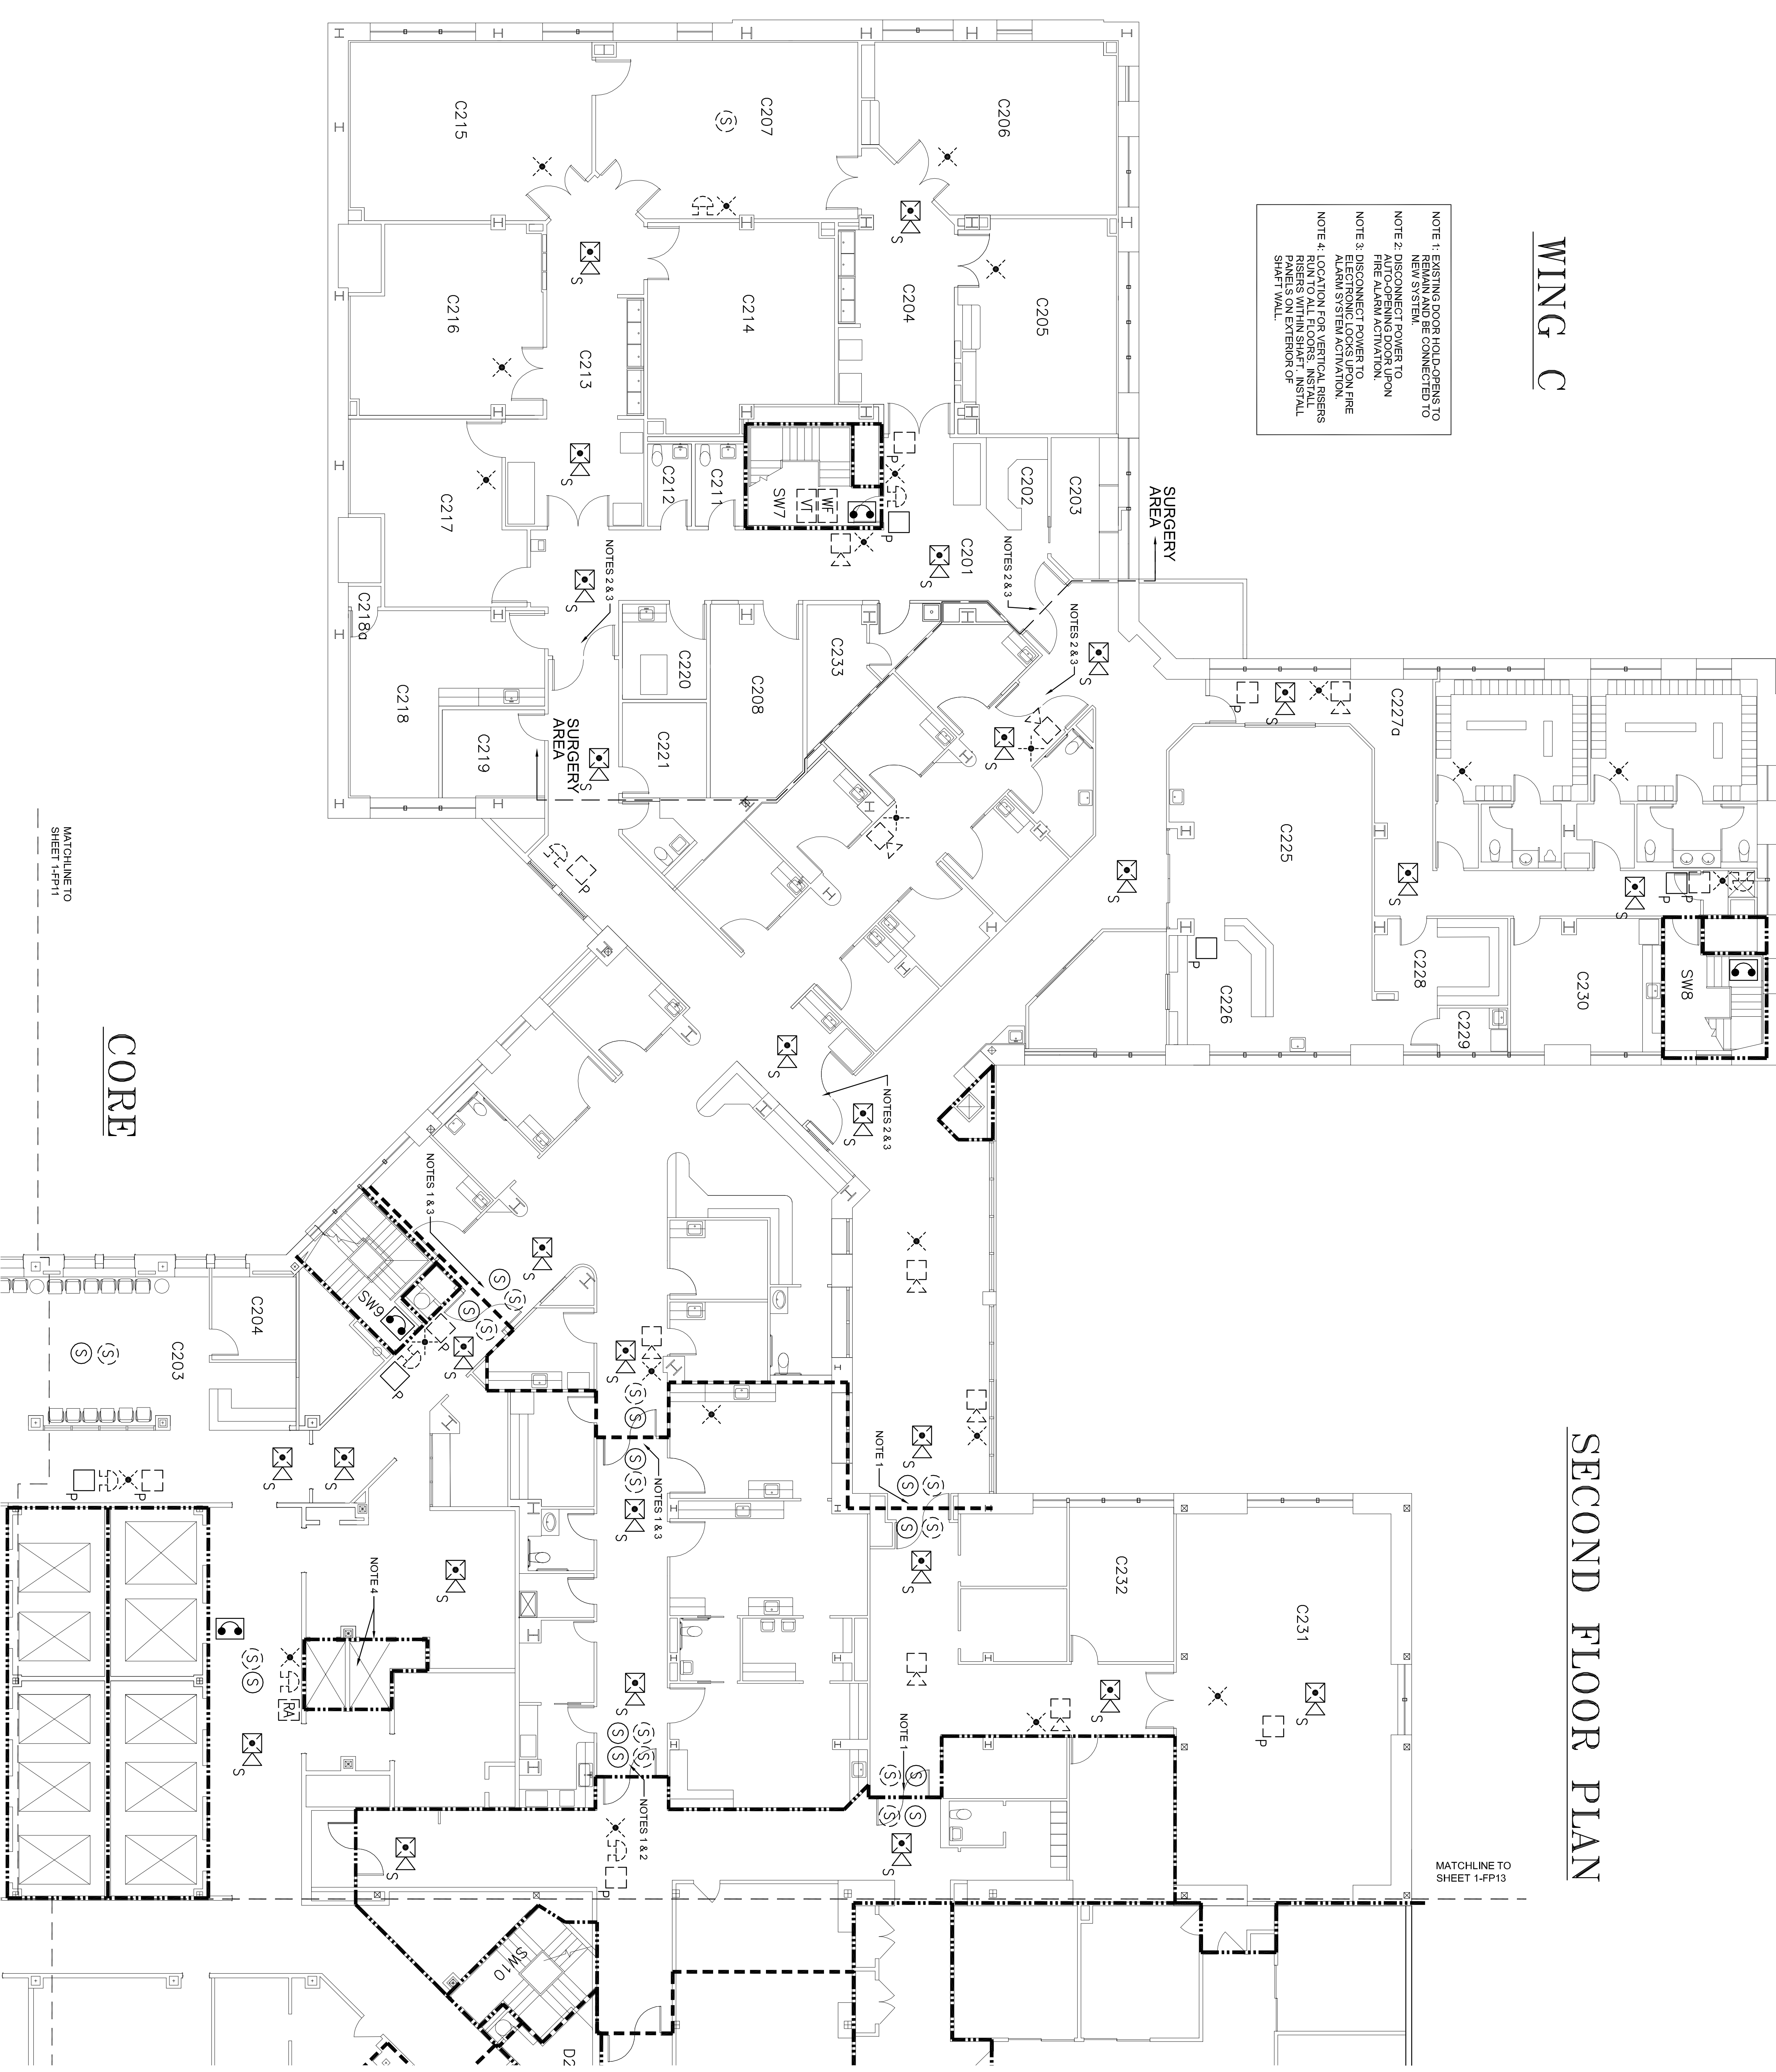

SECOND FLOOR PLAN

MATCHLINE TO SHEET 1-FP13

MATCHLINE TO SHEET 1-FP11

CORE

LEGEND

- EXISTING FIRE ALARM EQUIPMENT TO BE REMOVED**
- X FLASHING LIGHT
 - FL CHIME
 - MANUAL STATION
 - FIRE ALARM CONTROL PANEL
 - REMOTE ANNUNCIATOR
 - SMOKE DETECTOR
 - DUCT SMOKE DETECTOR
 - HORN
 - HEAT DETECTOR
 - FIREFIGHTER TELEPHONE JACK
- EXISTING FIRE ALARM EQUIPMENT TO REMAIN**
- [W] SPRINKLER WATERFLOW SWITCH (ADD MONITOR MODULE AND CONNECT TO NEW SYSTEM)
 - [V] SPRINKLER VALVE DAMPER SWITCH (ADD MONITOR MODULE AND CONNECT TO NEW SYSTEM)
 - [A] AUTOMATIC DOOR RELEASE (ADD CONTROL MODULE AND CONNECT TO NEW SYSTEM)
- NEW FIRE ALARM EQUIPMENT TO BE INSTALLED**
- [R] FIRE ALARM CONTROL PANEL
 - [RA] REMOTE ANNUNCIATOR
 - [S] STORE MOUNT EXCEPT WHERE NOTED
 - [S] (CEILING MOUNT EXCEPT WHERE NOTED)
 - [S] SPEAKER MOUNT EXCEPT WHERE NOTED
 - [S] COMBINATION SPEAKER-STROBE (CEILING MOUNT EXCEPT WHERE NOTED)
 - [S] HORN (CEILING MOUNT EXCEPT WHERE NOTED)
 - [S] COMBINATION HORN-STROBE (CEILING MOUNT EXCEPT WHERE NOTED)
 - [M] MANUAL STATION
 - [F] FIREFIGHTER TELEPHONE JACK
 - [S] SMOKE DETECTOR-PHOTOELECTRIC
 - [S] DUCT SMOKE DETECTOR
 - [OW] OPERATOR WORK STATION
 - [CC] FIRE COMMAND CENTER
 - [P] PRINTER
 - [R] RISER
 - [H] HEAT DETECTOR
- FIRE RATED WALL LEGEND:**
- SMOKE BARRIER
 - 2-HOUR FIRE RATED WALL
 - MISC. SYMBOLS
 - MATCHLINE

KEYPLAN

