


1. PROVIDE AND INSTALL SEPARATE INITIATING AND INDICATING DEVICE CIRCUITS PER FLOOR, AND SMOKE ZONE (.i.e., ONE OF EACH CIRCUIT FOR EACH SMOKE ZONE).
2. SEE FLOOR PLANS FOR DEVICE LOCATIONS AND QUANTITIES.
3. COORDINATE WITH VA FOR LOCATION OF VERTICAL CONDUIT FOR RISERS.
4. NOT SHOWN, BUT TO BE PROVIDED: SEPARATE CONDUIT AND WIRE FOR OUTGOING AND RETURN CONDUCTORS, TO COMPLY WITH NFPA 72 6.4.2.2.2. PLACE NEW CONDUIT FOR OUTGOING CONDUCTORS ON OPPOSITE WALL FROM CONDUIT FOR RETURN CONDUCTORS.

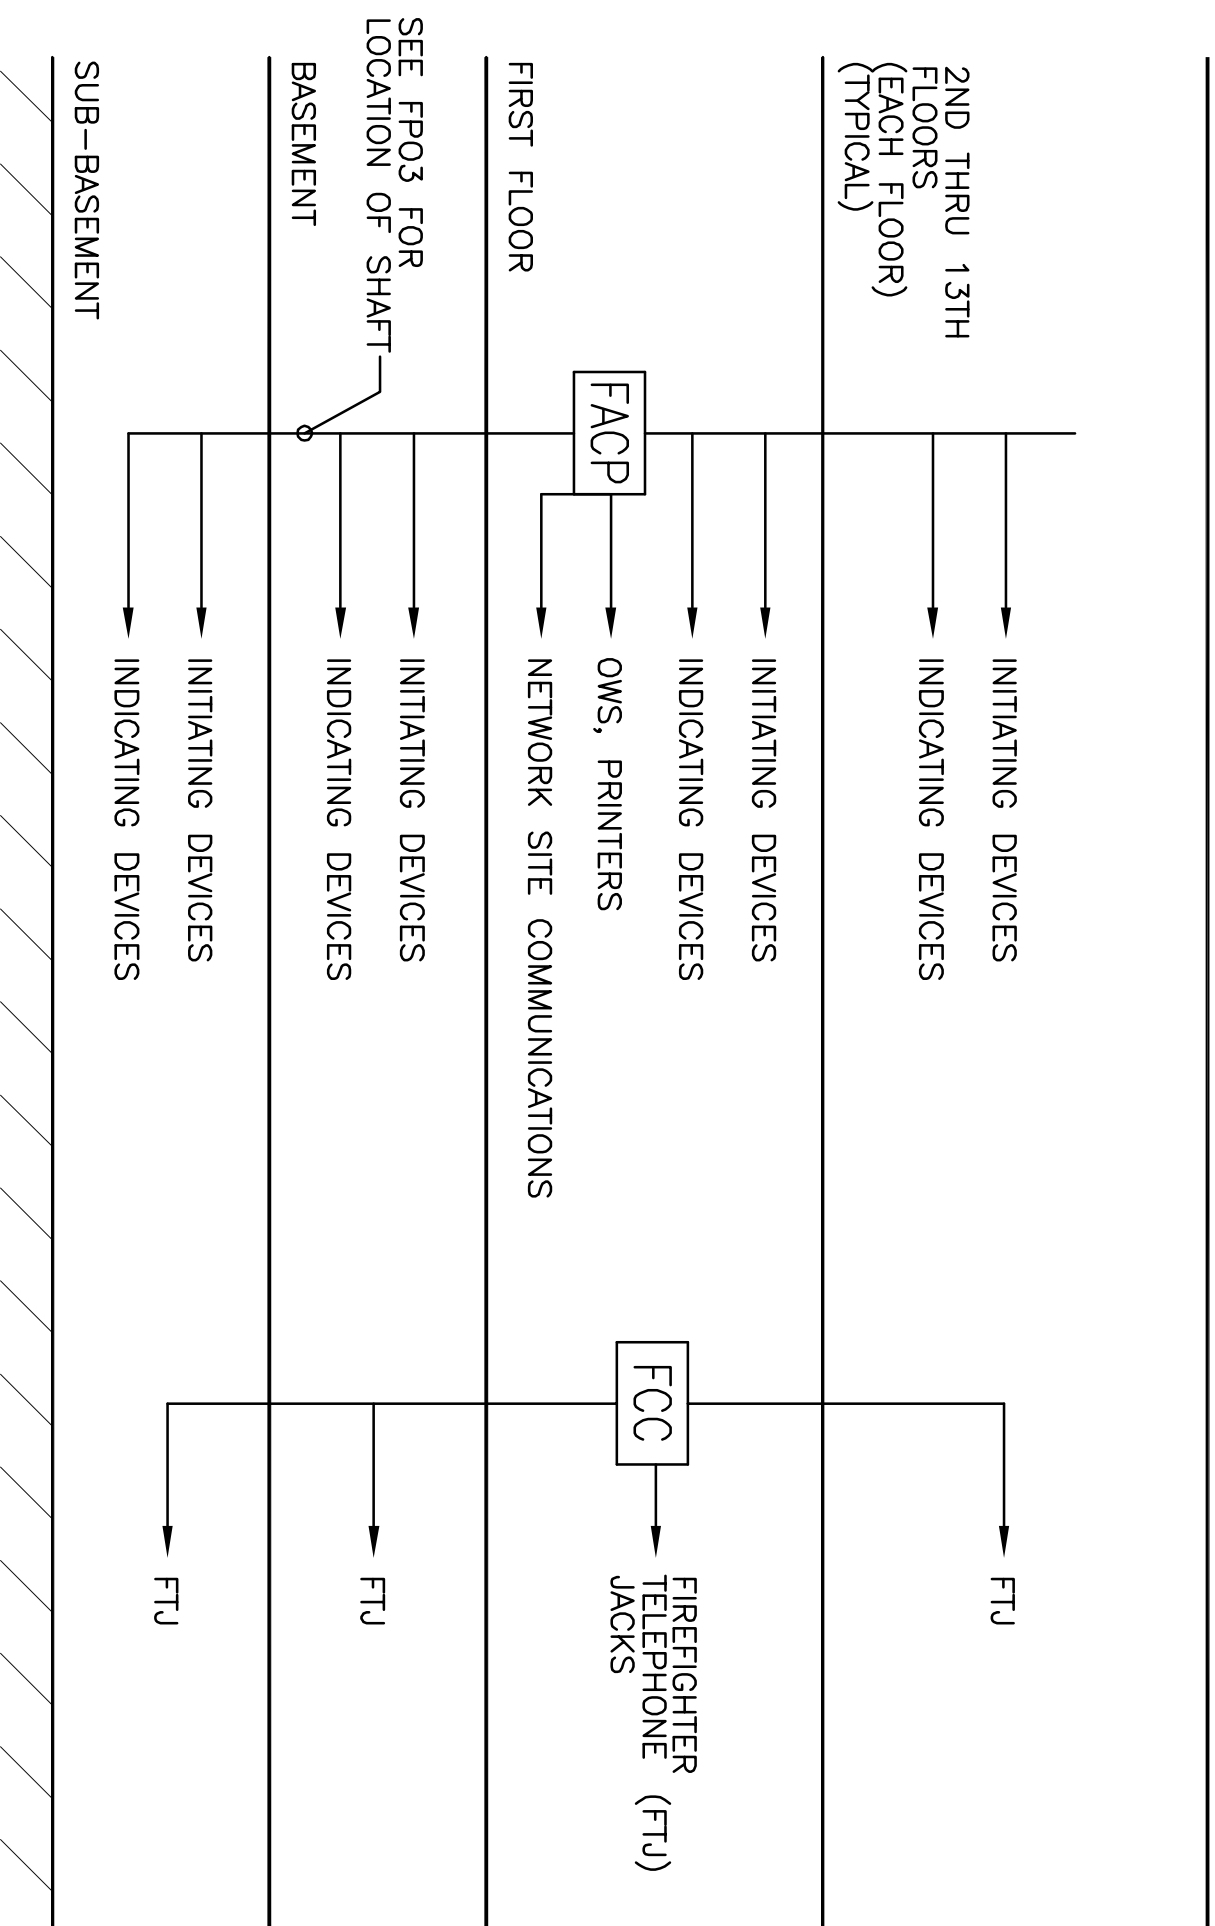

7
NO SCALE

RISER DIAGRAM – MAIN BUILDING